



**KUPO**  
CONTROL

IAPMO-R&T



GasMark





## TECHNICAL DETAILS

Installation of these valves can only be performed by authorised persons and must be in compliance with gas installation codes and any local authority regulations.



AS Certificate No: GMK 10303

<b>Model</b>	: CV 983
<b>Max Inlet pressure</b>	: 3.5 kPa
<b>Max Flow</b>	: 2.3 M <sup>3</sup> /h (Air)
<b>Regulator Range</b>	: 0.7-0.1 kPa (NG) 2.0-2.6kPa (Propane)
<b>Regulator Class</b>	: 3
<b>Regulator Grade</b>	: 20
<b>Valve Class</b>	: 2
<b>Temperature Limitations</b>	: -10 + 80 °C
<b>Voltages</b>	: 24 and 240 VAC
<b>Mounting Limitations</b>	: Any position except coil facing down
<b>Connections</b>	: 15mm (1/2") BSP(1507)

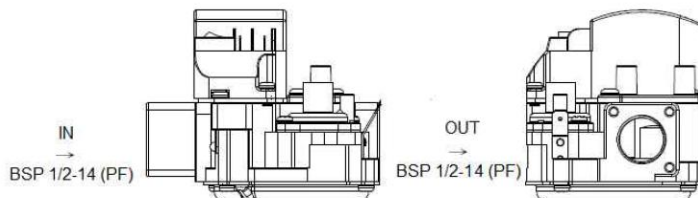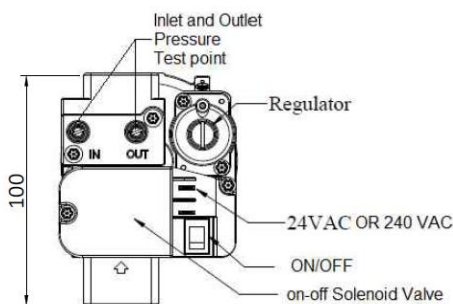

## TECHRITE CONTROLS AUSTRALIA PTY.LTD

Victoria - Head Office  
12 Yiannis Court  
Springvale, VIC 3171  
Phone:+61 3 9549 4444  
Fax:+61 3 9546 6069

New South Wales Office  
Unit 10/19 Boden Road  
Seven Hills NSW 2147  
Phone:+61 2 9624 4486  
Fax:+61 2 9624 6449

Queensland Office  
Unit 20, 28 Burnside Road  
Ormeau QLD 4208  
Phone:+61 7 3807 9094  
Fax:+61 7 3807 9095

Email: [techrite@techrite.com.au](mailto:techrite@techrite.com.au)

[www.techrite.com.au](http://www.techrite.com.au)